


Cook Road Pump Station Exhibits 03.01.19

Name	Modified	Sharing	Modified By	Activity
------	----------	---------	-------------	----------

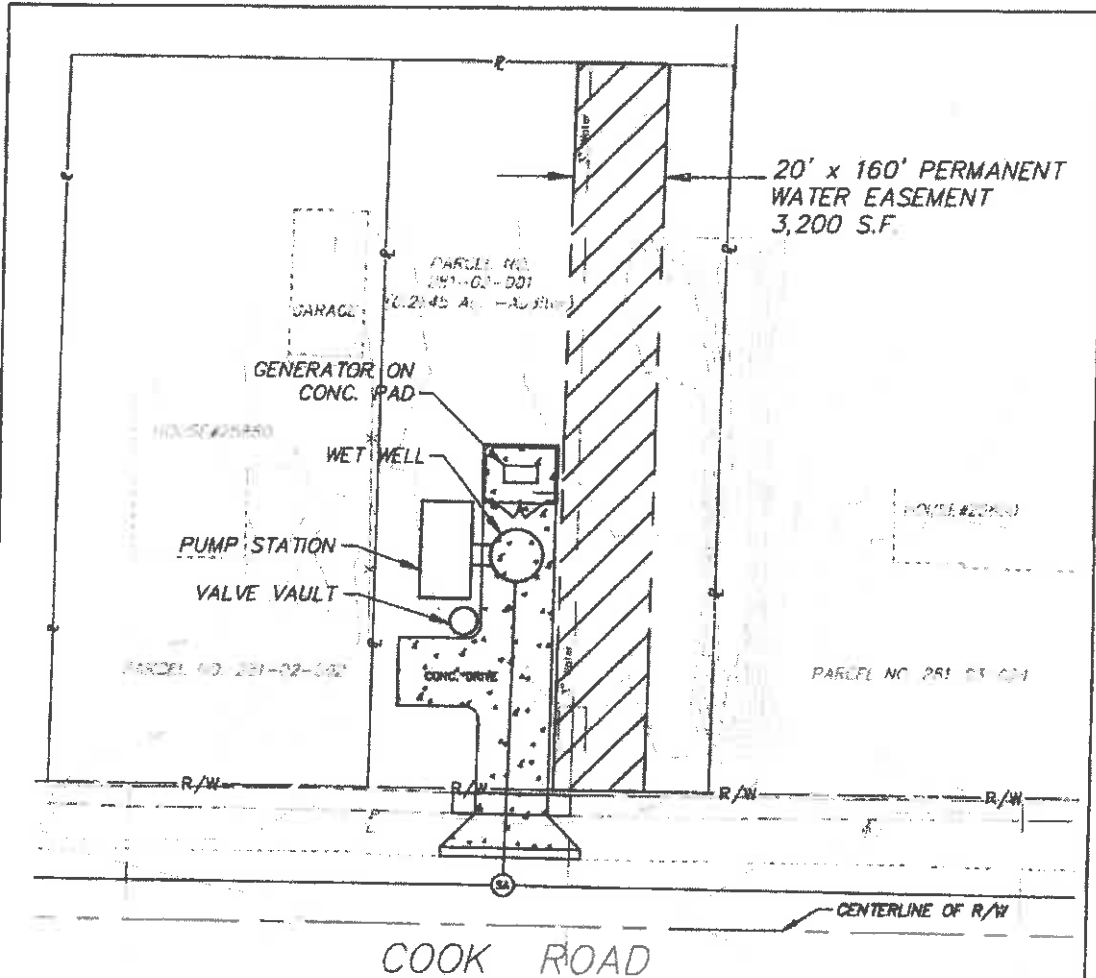

COMMENTS:

CVE CHAGRIN VALLEY ENGINEERING, LTD.

Quality Engineers. Analytical Solutions.

2575 N. 101ST SUITE 100, WILSON, OHIO 44094-1000
 440.437.1199 Fax: 440.437.1529

**COOK & COLUMBIA ROAD
SANITARY SEWER
COOK RD PUMP STATION**

**P.P. No. 281-02-001
Cook Road
Donauschwabens German
August 2018**